



GENERAL NOTES

1. COORDINATE EXACT LOCATION OF EACH LIGHTING FIXTURE WITH CABLE TRAY LAYOUTS AND AIR DUCT LAYOUTS.
2. FIXTURES SHALL BE LOCATED AT THE SAME ELEVATION IN EACH ROOM, UNLESS NOTED OTHERWISE.
3. FOR LIGHTING PANEL SCHEDULES SEE DWG E9.21.34
4. FOR LIGHTING FIXTURE SCHEDULES SEE DWG E9.30.01
5. PROVIDE 2" RIGID GALVANIZED STEEL SLEEVES FOR ALL CONCRETE CEILING AND WALL CONDUIT PENETRATIONS.

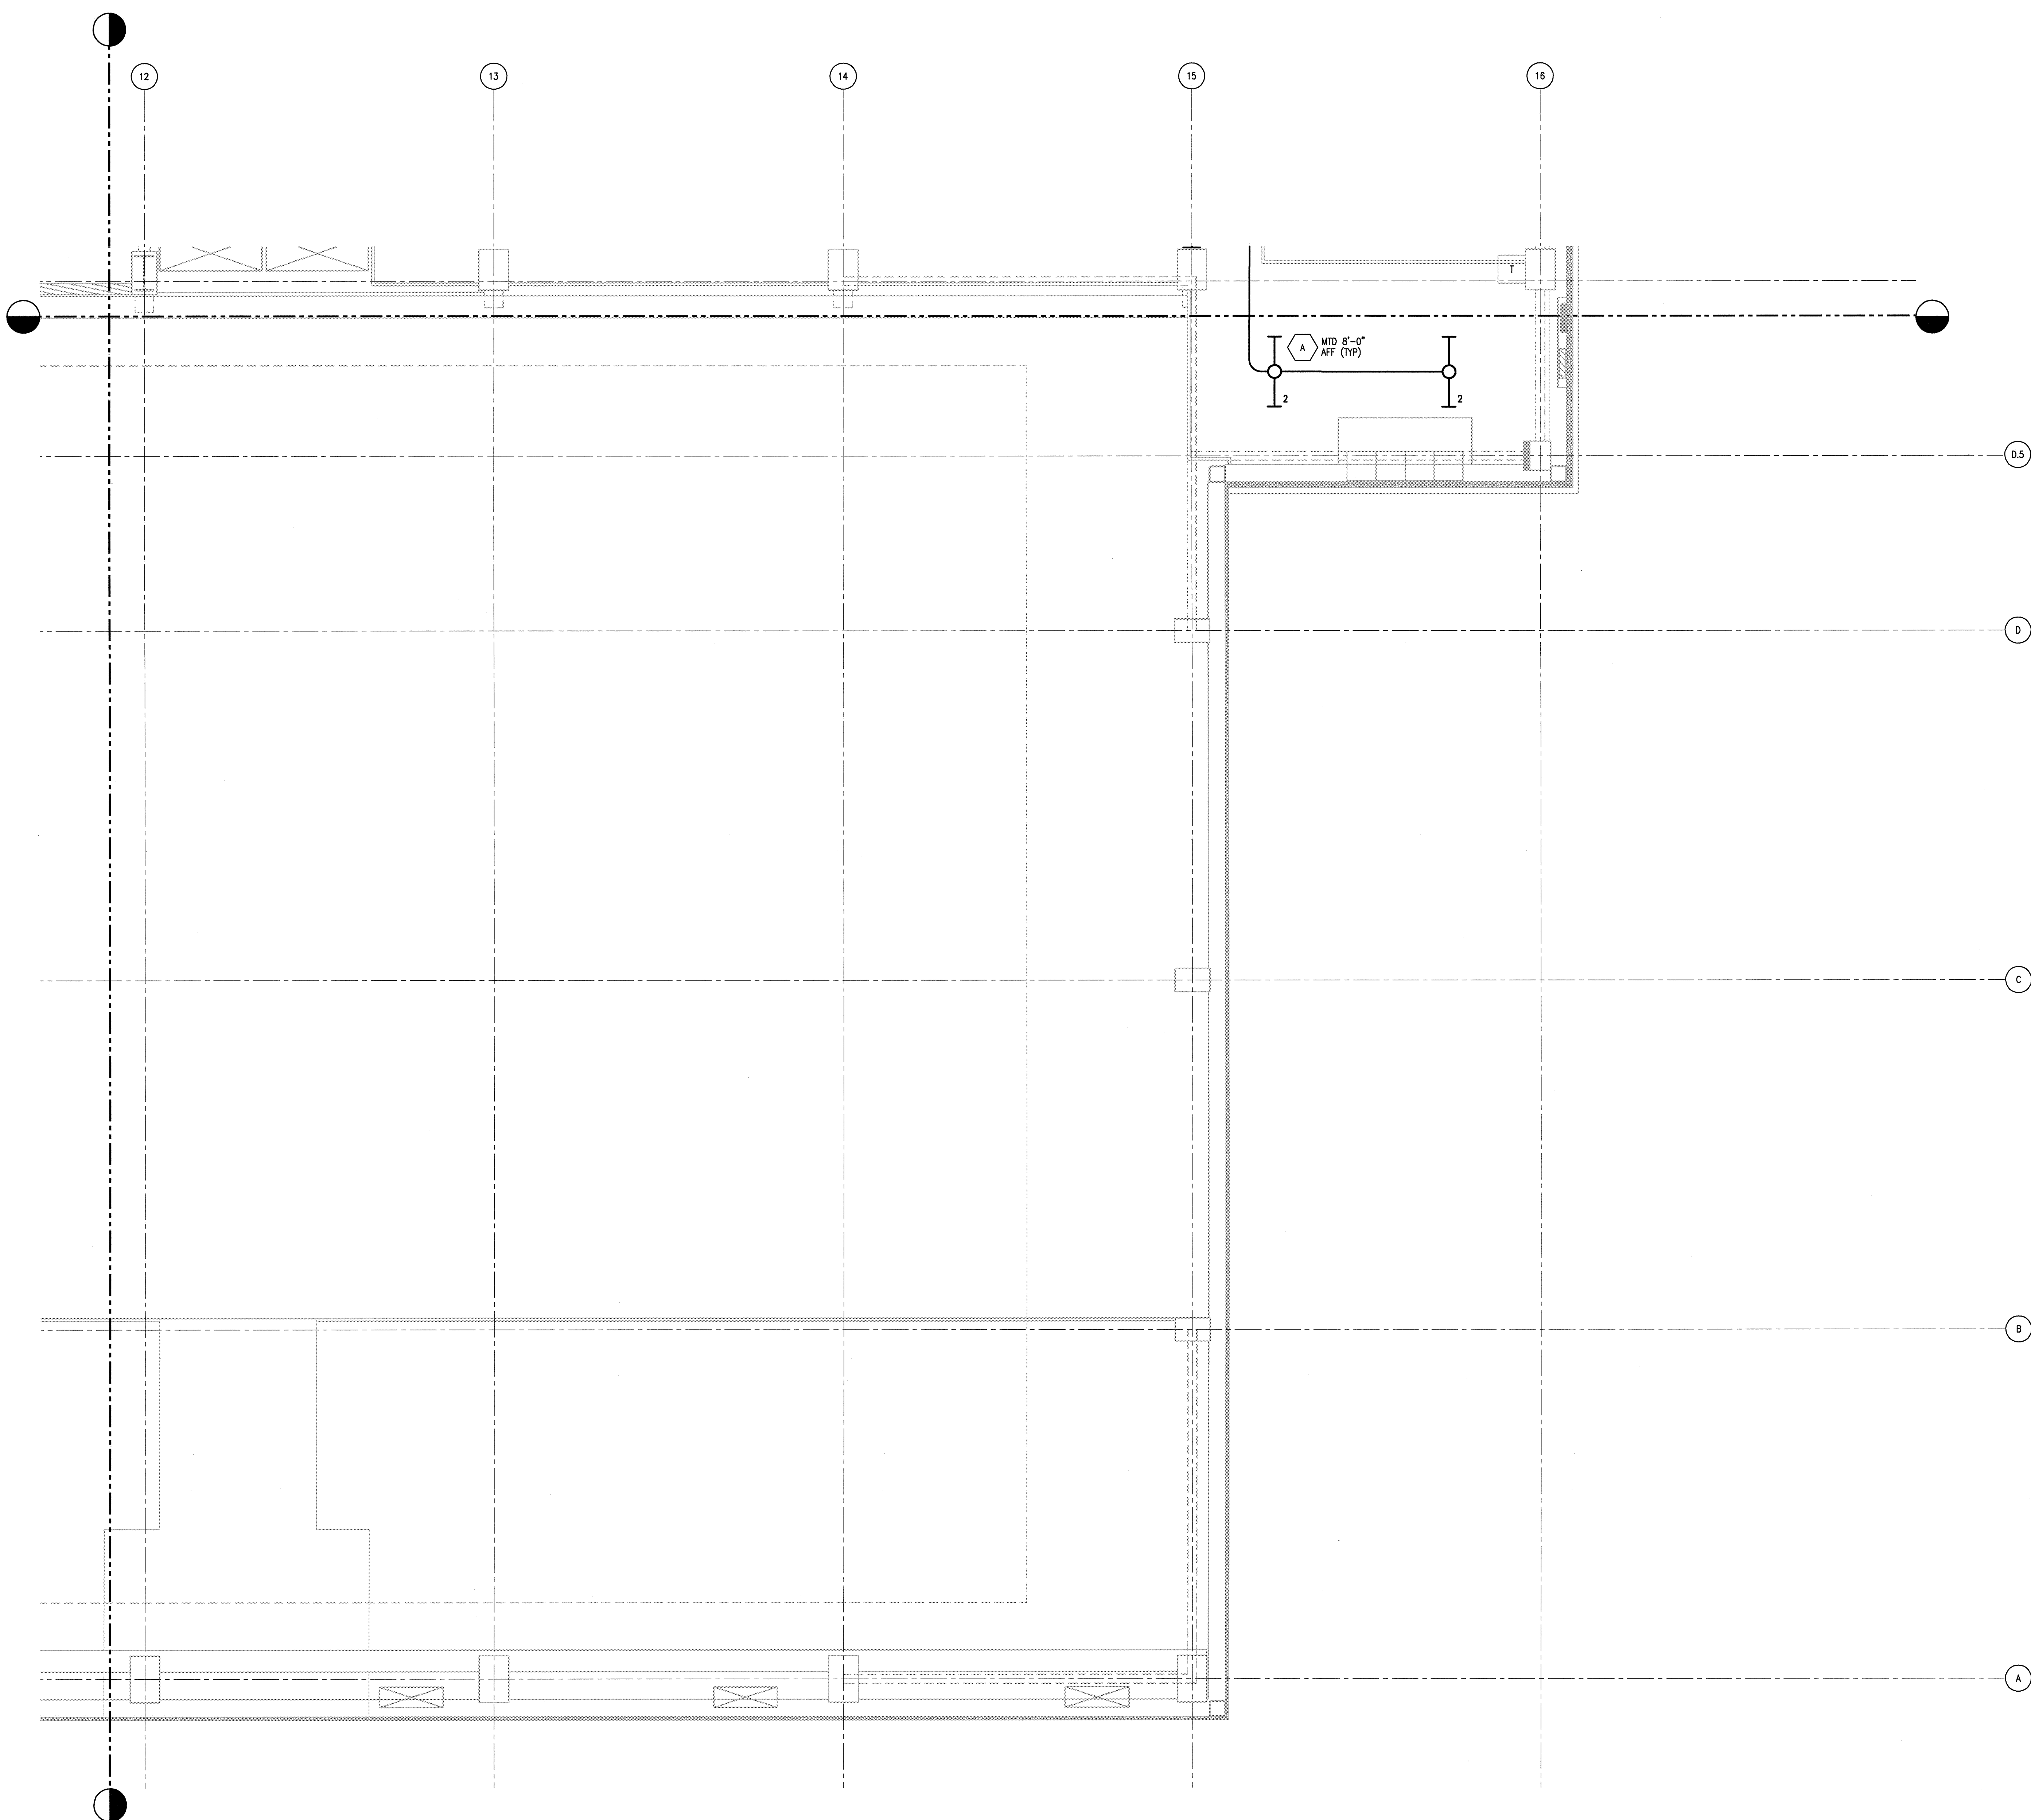

4' 2' 0 4'

SCALE: $1/4" = 1'-0"$

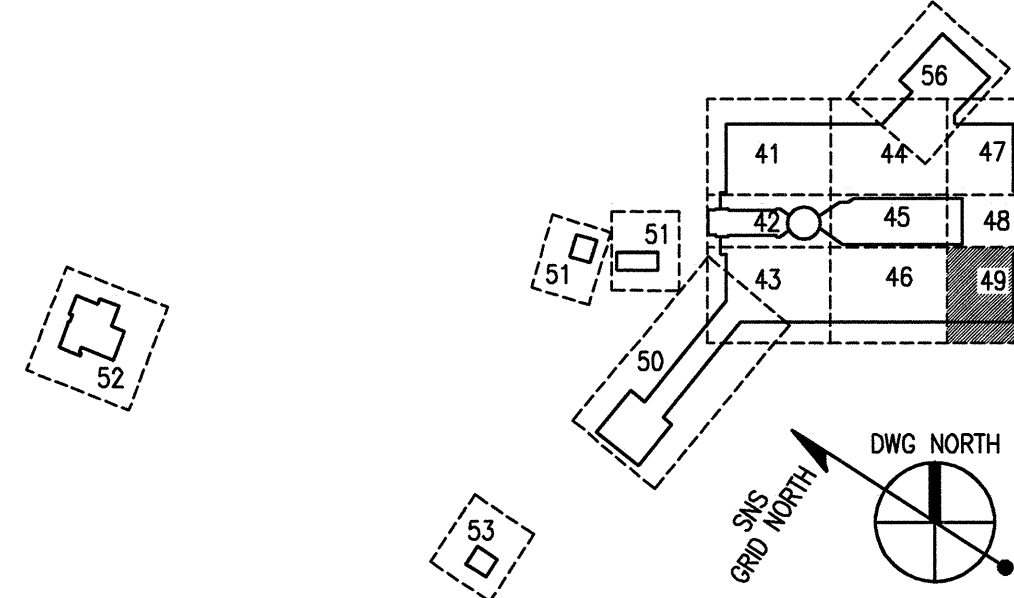

108030700-E8E-8700-A198



Knight/Jacobs Joint Venture
701 Scarborough Road, MS 8253
Oak Ridge, TN 37830
865-241-9433
fax 865-241-3400




Oak Ridge National Laboratory
managed for the DEPARTMENT OF ENERGY under
U.S. GOVERNMENT contract DE-AC05-00OR2272
UT-BATTTELLE, LLC • Oak Ridge, Tennessee

PROJECT NAME:	
SPALLATION NEUTRON SOURCE	
TARGET BUILDING	

TARGET BUILDING										
ELECTRICAL LIGHTING PLAN										
LEVEL 3, SECTOR 49										
1	3	48	49	50	PLANT	BLDG	FL	SH.	OF	TYPE
			X	X	8	8700		1	1	P
51			52		53	WBS				
NC			NA			1.8.3.7				E3.03.49

NO REPRESENTATION OR WARRANTY, EXPRESSED OR IMPLIED, IS MADE AS TO THE ACCURACY, COMPLETENESS OR USEFULNESS OF THE INFORMATION OR STATEMENTS CONTAINED IN THESE DRAWINGS, OR THAT THE USE OR DISCLOSURE OF ANY INFORMATION, APPARATUS, METHOD, OR PROCESS DISCLOSED IN THESE DRAWINGS MAY NOT INFRINGE PRIVATE RIGHTS OF OTHERS. NO LIABILITY IS ASSUMED WITH RESPECT TO THE USE OF, OR FOR DAMAGES RESULTING FROM THE USE OF ANY INFORMATION, APPARATUS, METHOD, OR PROCESS DISCLOSED IN THESE DRAWINGS. DRAWINGS MADE AVAILABLE FOR INFORMATION TO BIDDER ARE NOT TO BE USED FOR OTHER PURPOSES AND ARE TO BE RETURNED UPON REQUEST.

NUMBER OF-
SECTION OR
DETAIL


DRAWING ON WHICH SECTION OR DETAIL IS SHOWN OR

SECTION AND DETAIL KEY

THIS DOCUMENT
CONTROLLED BY

CONTROLLED BY

CHANGE CONTROL
SYSTEM 3

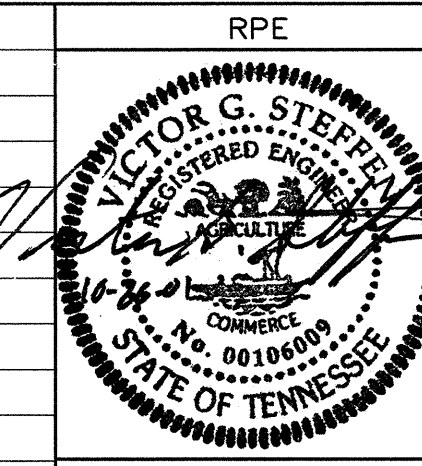[illegible]

DSN	H GROVER	10/26/01
DRW	L MAKOVSKY	10/26/01
CHK	V STEFFEN	10/26/01
DEPT		
PE	<i>[Signature]</i>	11/14/01
PJ	<i>[Signature]</i>	11/17/01
REQ		
UTB	<i>[Signature]</i>	11/16/01